


# Direct Fresh Air Cooling Specifications

- Direct Fresh Air Cooling
- Ultra-low contracted PUE of 1.2
- Average supply temperature 20°C – 25°C ± 2°C
- N+1 Cooling infrastructure delivered under floor with (CRAC) units
- Heat rejection installed to take air away from white space
- Moisture detection and control sensors
- Back up Direct Exchange system for ancillary cooling and full Tier 3 aligned resilient back up on very hot days
- Full N+1 DX back up cooling infrastructure

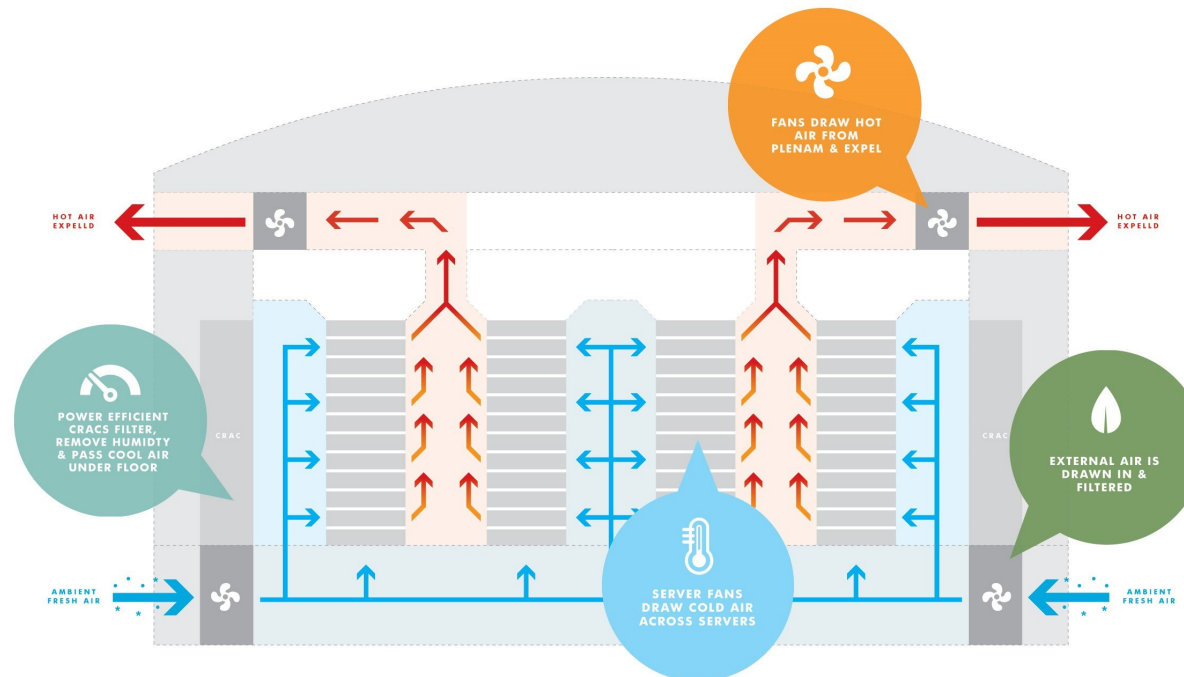

Contact us:

[enquiries@aegisdata.net](mailto:enquiries@aegisdata.net)

| 0203 0115 115

| [www.aegisdata.net](http://www.aegisdata.net)

